



CRYOLATOR ROTOR MOTOR MOUNT
230/460V, 3 PHASE FROM MIXER
(OR HYDRAULIC AS SHOWN) INPUT

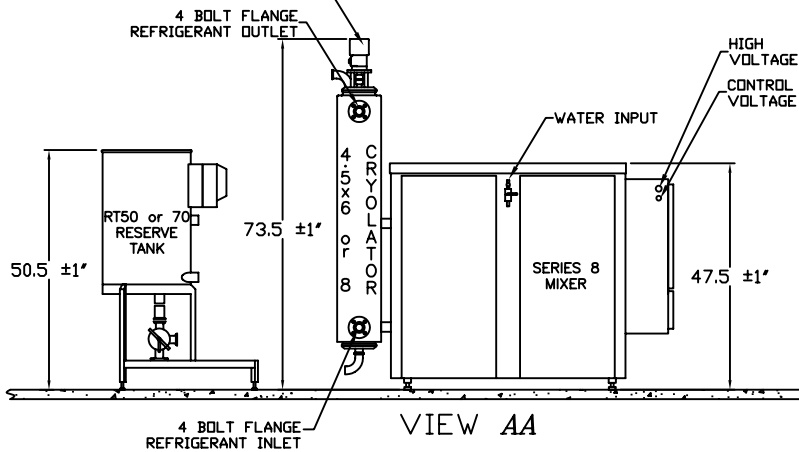

VIEW AA

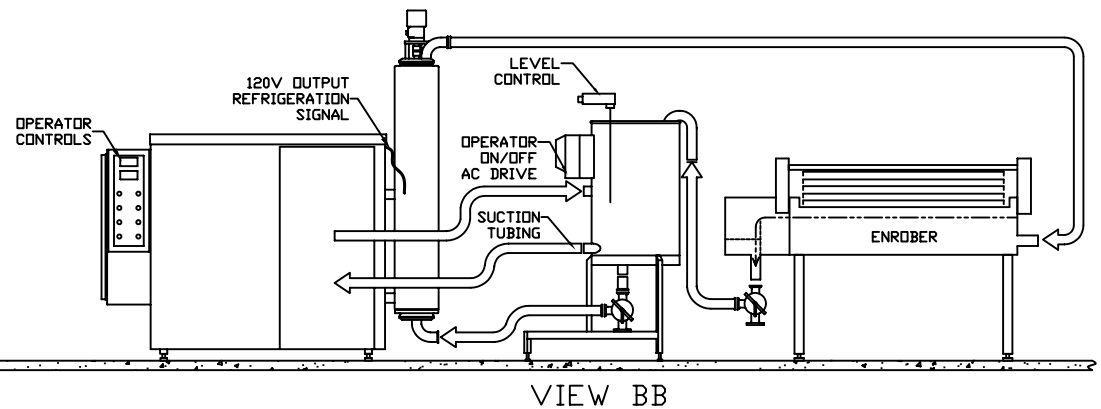

VIEW BB

NOTES:

1. SERIES 8 MIXER ELECTRICAL:
 - SERIES 850 = 4-1/2 HP., 230/460V., 3 PH., 60 Hz.
 - SERIES 870 = 7-1/2 HP., 230/460V., 3 PH., 60 Hz.
 - 120 VOLT INPUT FOR OPERATOR CONTROL CIRCUIT.
- MIXER WATER INPUT
 - SERIES 850 = 12 GPM. @ 40 PSI. WITH 1/2" SUPPLY MINIMUM.
 - SERIES 870 = 20 GPM. @ 40 PSI. WITH 3/4" SUPPLY MINIMUM.
2. CRYOLATOR 4.5x6 & 4.5x8
 - ELECTRICAL = 2 HP., 230/460V., 3 PH., 60Hz.
 - HYDRAULIC = 8 GPM. @ 800 PSI.
3. RESERVE TANK - RT50 & RT70
 - ELECTRICAL - 230V/460V., 3 PH., 60 Hz.
 - HYDRAULIC - 14 GPM. @ 800 PSI.
4. CONNECTIONS SHOULD NOT INTERFERE WITH EQUIPMENT FUNCTION.
5. FOOD VINYL TUBE (REINFORCED FOR SUCTION) IS USED FOR CONNECTIONS. TUBE BENDS ARE USED AS NEEDED TO PREVENT KINKING.
6. THE MIXING SYSTEM SHOULD NOT BE MORE THAN TWO FEET FROM THE APPLICATOR.
7. MIXER MUST HAVE 22" CLEARANCE ON BOTH SIDES TO OPEN DOORS.



Wilevco, Inc.
10 Fortune Drive
Billerica, MA 01821-3996
Phone: (978) 667-0400
Fax: (978) 670-9191

THIS DRAWING AND ANY DESIGN
HEREON IS COPYRIGHT AND REMAINS
THE PROPERTY OF WILEVCO INC. IT
MAY NOT BE COPIED, LOANED OR
DISCLOSED TO A THIRD PARTY
WITHOUT WRITTEN CONSENT. IT IS
SUBJECT TO RECALL.

No.	Revision	Description	Date	By/APP.

**INSTALLATION LAYOUT
SERIES 8 MIXER, CRYOLATOR
RESERVE TANK & ENROBER**

Scale: 1 = 1 Date: 08/29/2007 Drawn By: M. R. Lohkamp
DWG No. Name: SE - 0735